



The Machado Environmental Corporation HVAC Cleaning Inspection



1 800 358-3828

1. a) Is the **fiberglass deteriorating** in the air handler, fan coil unit or plenum?
(Second picture shows foil on foil faced fiberglass flaking.)





- b) Is the **fiberglass damp** or wet?

2. Are the **evaporator coils** dirty or blocked?

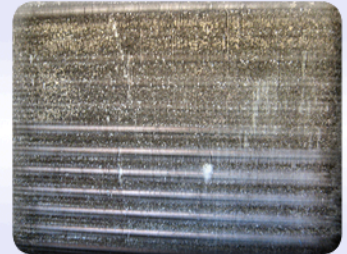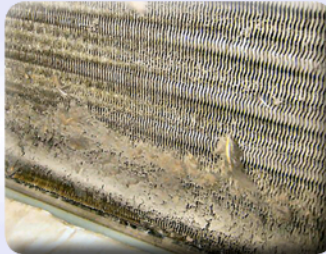

3. Is the **blower** dirty?

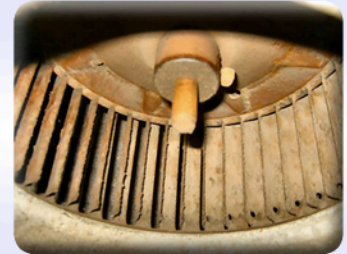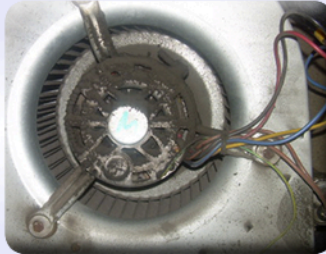

4. Is there slime or rust in the **drain pan**?



5. Are there bird dropping or other **unsanitary things** around the air handler?

